


MINIMUM CLEARANCE SCHEDULE			
SIZE (BFPD)	A	B	C
3/4" - LARGER	12"	24"	12"

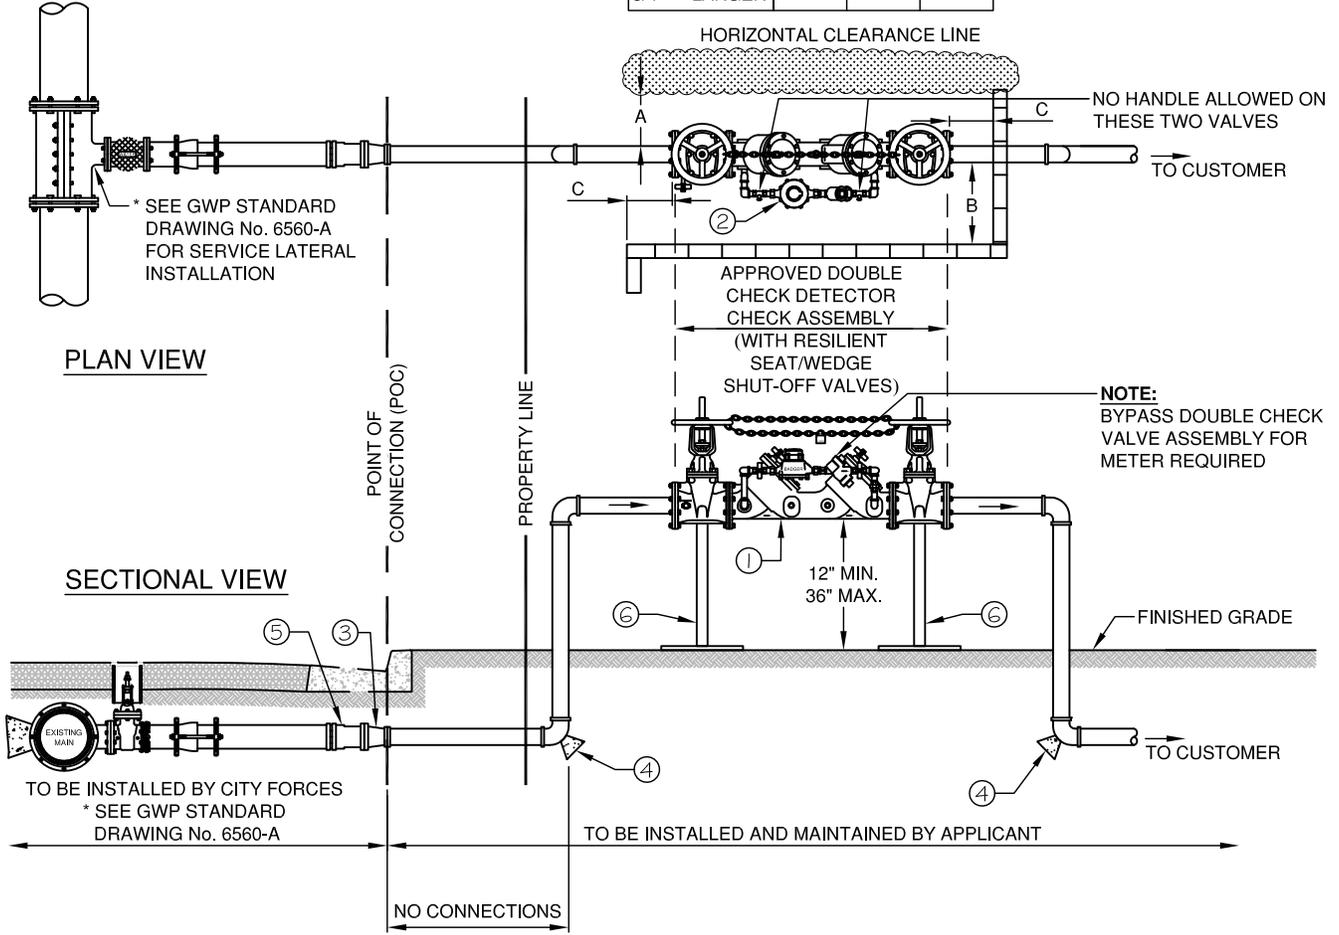

DETAIL	DESCRIPTION
①	DOUBLE CHECK DETECTOR CHECK ASSEMBLY-APPROVED BY HEALTH AGENCY.
②	BYPASS METER TO BE FURNISHED BY GWP AT CUSTOMERS EXPENSE.
③	4" x 3" FLG. x FLG. REDUCER (WHEN NEEDED)
④	SEE GWP STD. DWG. No. 6083-A FOR THRUST BLOCK INSTALLATION
⑤	4" M.J. x FLG. ADAPTOR
⑥	ADJUSTABLE PIPE SUPPORT. SEE GWP STD. DWG. No. 6682-A.

* ACCOMPANYING GWP STD. DWG. No. 6083-A, 6560-A, 6528-A, 6682-A & 6562-A

**GLENDALE WATER & POWER
CITY OF GLENDALE
CALIFORNIA**

**STANDARD FIRE LINE INSTALLATION
WITH DOUBLE CHECK DETECTOR
CHECK ASSEMBLY - (3" - 12")**

APPROVED  07/14/2015
GERALD TOM, SENIOR CIVIL ENGINEER, R.C.E. No. C51209 DATE
GLENDALE WATER AND POWER - WATER DEPARTMENT

DES: LB
D: GR/PN
SCALE: NONE
DATE: 07/14/15
C: GT
APP:

SHEET No. 1 OF 1
6561-A